



July 10, 2017

Portsmouth Water Supply Status Report

Overview

The following Portsmouth Water Supply Status Report provides the Portsmouth Water customers an assessment of the current water supply conditions. This report is distributed routinely via the City of Portsmouth’s website at: www.Cityofportsmouth.com/publicworks - water

Water Use Restrictions

Customer Water Restrictions
N/A
None
Voluntary Measures
Odd/Even Watering
Two-Days per Week Watering
No Lawn Watering

The current water supply conditions have recovered from the drought that occurred in 2016. There are currently no water restrictions in place, however hot and dry days can still impact our water system with high demands so we continue to ask our water customers to please use water wisely, minimize waste, and incorporate water efficient fixtures and appliances whenever possible. In an effort to support this goal, the City continues to offer all residential water customers rebates for the installation of low-flow toilets and high-efficiency washing machines. More details can be found in the Public Works Billing Information section of the City’s website.

Precipitation events in late-2016 and early-2017 have helped to recharge the Bellamy Reservoir, increase stream flows and cause groundwater levels to rise to conditions typical for this time of year. Water operations staff continue to assess the supply conditions and will provide updates at least monthly.

Additional updates and tips regarding water efficiency can be accessed at the cityofportsmouth.com.

Current Customer Water Demand

Current Water Demand
Below Normal
Normal
Above Normal
High
Very High
Historic High

Water demand is **Below Normal** at this time.

Generally cooler and wetter weather this spring and early summer has helped keep water demand below normal. Water Demand is a factor in the supply status assessment that is measured by the amount of water delivered through the water system. This factor reflects customer usage and variations caused by daily, weekly and seasonal changes in business, residential and irrigation demands.

Month	Monthly Demand (Million Gallons per Day (MGD))	Historic Average Demand (ten-year average (MGD))
June 2016	5.62	5.07
July 2016	6.09	5.49
August 2016	5.66	5.51
September 2016	4.47	4.96
October 2016	3.89	4.23
November 2016	3.59	4.01
December 2016	3.79	3.93
January 2017	3.69	4.11
February 2017	3.54	4.20
March 2017	3.68	4.18
April 2017	4.01	4.14
May 2017	4.14	4.73
June 2017	4.83	5.15

Average daily water demand was 4.83 million gallons per day (MGD) in June 2017, which is 6.2% below the 10-year normal for this time of year and 0.79 MGD lower than demand in June 2016.

Precipitation Status


Precipitation
Above Average
Average
Below Average
Dry
Very Dry
Drought

Total June precipitation in Portsmouth was 3.91 inches. This is very close to normal for the month. Over the past three months there has been 15.63 inches of precipitation which is 25% more than the normal precipitation over this period. Three storm events, each yielding from 1.13 to 1.25 inches, occurred in June. In terms of the water-year (October through September), the cumulative precipitation is currently 3.79 inches above the historic average for this time period.

In order to assess annual precipitation conditions, total precipitation over a rolling 12-month period is compared to the mean annual precipitation of 47.20 inches. Precipitation over the past 12-months, through June, totals 47.39 inches. An above normal amount of precipitation over 12-months has not occurred since January 2012.

The following graphic illustrates the monthly deviations from average precipitation over 2016 and 2017.

Monthly vs. 30-Year Mean Precipitation

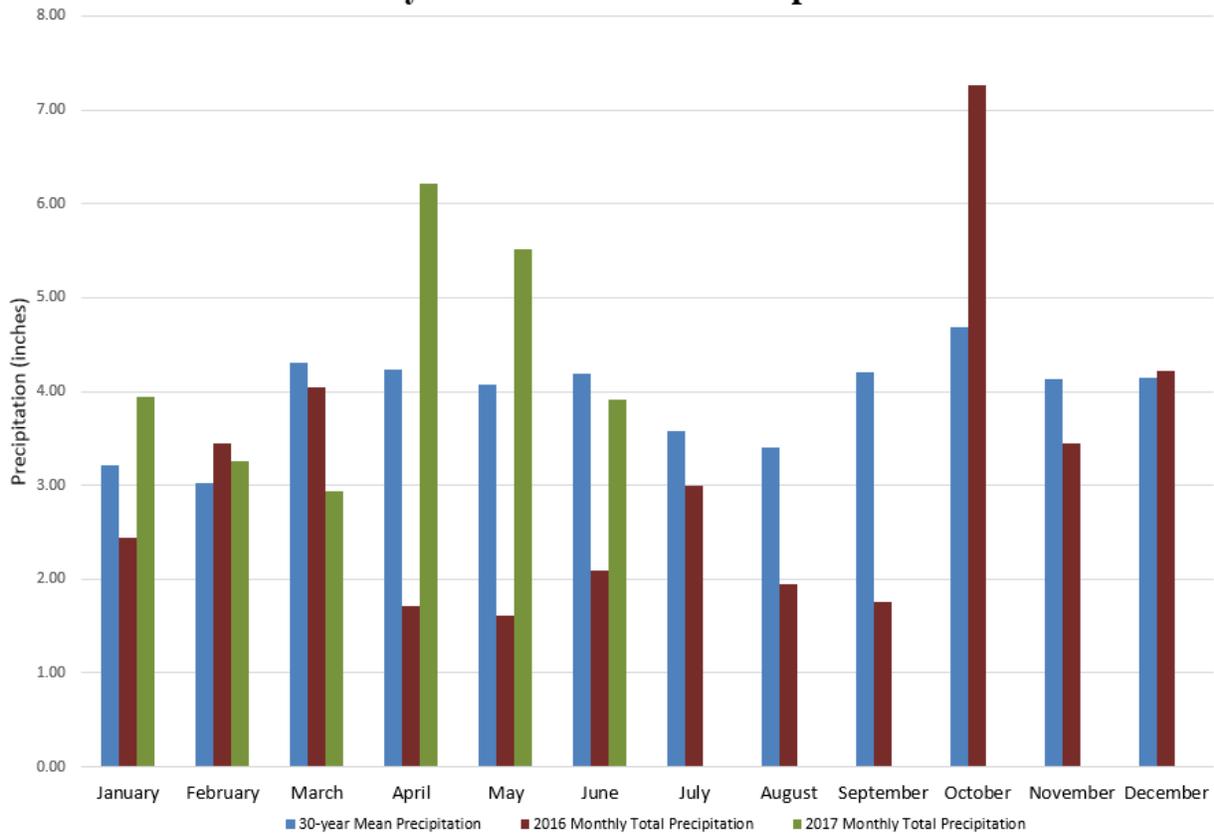

Groundwater Levels

Groundwater Levels
Above Average
Average
Below Average
Low
Very Low
Drought

Currently the groundwater levels are considered **Above Average**. Groundwater levels have risen to levels that are slightly above normal for this time of year. Groundwater levels peaked in mid-June and are now dropping as is typically over the summer.

Overall conditions of aquifer water levels are assessed with respect to water levels that are continuously monitored in the Portsmouth Water Supply wells. Based on historic water-level data, average water levels have been identified for a representative well in each well-field area for each month of the year. Assessments of the aquifer levels are made relative to average levels, historic low levels, and available drawdown in the wells.


Groundwater from wells in Madbury, Portsmouth and Greenland typically provide between 34% and 45% of the water supply to Portsmouth customers, with the remaining 55% to 66% from the Bellamy Reservoir. In June 2017, 39% of the supply came from wells, 61% from the reservoir.

River Flow

River Flow
Above Average
Average
Below Average
Low
Very Low
Drought

Portsmouth Water System operators track the USGS stream flow gauges in the Oyster River and Lamprey River to assess flow conditions. These gauged watersheds are used to assess the relative recharge to the Bellamy Reservoir through its tributaries, the Bellamy River and Mallego Brook.

Storms in late-May and early-June caused flows in the Oyster River and the Lamprey River to remain higher than historic averages until the last week of June.

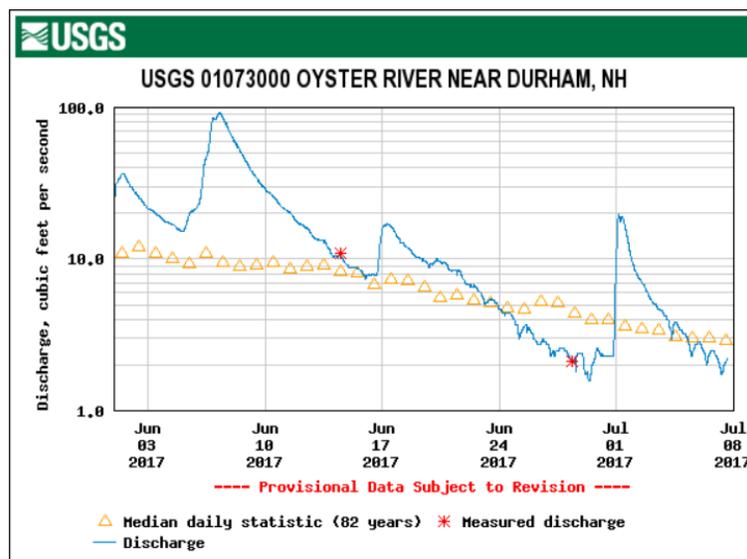

The monthly mean stream flow in the Oyster River at the USGS gauge was 17.40 cfs in June. This is 6.25 cfs (56%) higher than the 30-year June median flow rate of 11.15 cfs.

The monthly mean June stream flow in the Lamprey River at the USGS gauge was 269 cfs, which is 102 cfs (61%) higher than the 30-year June median flow rate of 167 cfs.

The current river flow conditions are considered **Above Average**.

Reservoir Level

Reservoir Level
Above Average
Average
Below Average
Low
Very Low
Drought

The current stage of the reservoir is considered to be **Average** for this time of year. The precipitation that has occurred over the past eight months has caused the reservoir to recharge and remain at levels typical for this time of year.

As the surface water source for the Madbury Water Treatment Facility, the Bellamy Reservoir is monitored to assess and predict the overall amount of water available for the Treatment Facility. Reservoir water levels are compared to typical monthly levels to assess the reservoir conditions.

At this time the Bellamy Reservoir water level is 0.15 feet above the spillway and the reservoir has approximately 648 million gallons of water above the surface water intake.

Water Supply Capability


Water Supply Capability
Above Normal
Normal
Below Normal
Restrictions Necessary
Additional Restrictions Necessary
Emergency

Water Supply Capability is a measure used to identify any issues with the Portsmouth Water Supply System that would result in a limitation to the amount of water that could be supplied. These could be lack of supply, issues with source water quality, or mechanical failures of system components.

The loss of the Haven Well as a water source (which contributed approximately 10% of the water system’s overall capability) has reduced the amount of water that can be provided to the system. As a result of this reduced capacity, the water supply capability is considered **Below Normal** at this time.

All of the other wells and the treatment facility are in good operational condition, thus the water demand is currently being met with conservative protections and redundancy in the system. That doesn’t rule out the need for periodic restrictions should mechanical or other failures occur.

System Capacity & Utilization (June 2017)

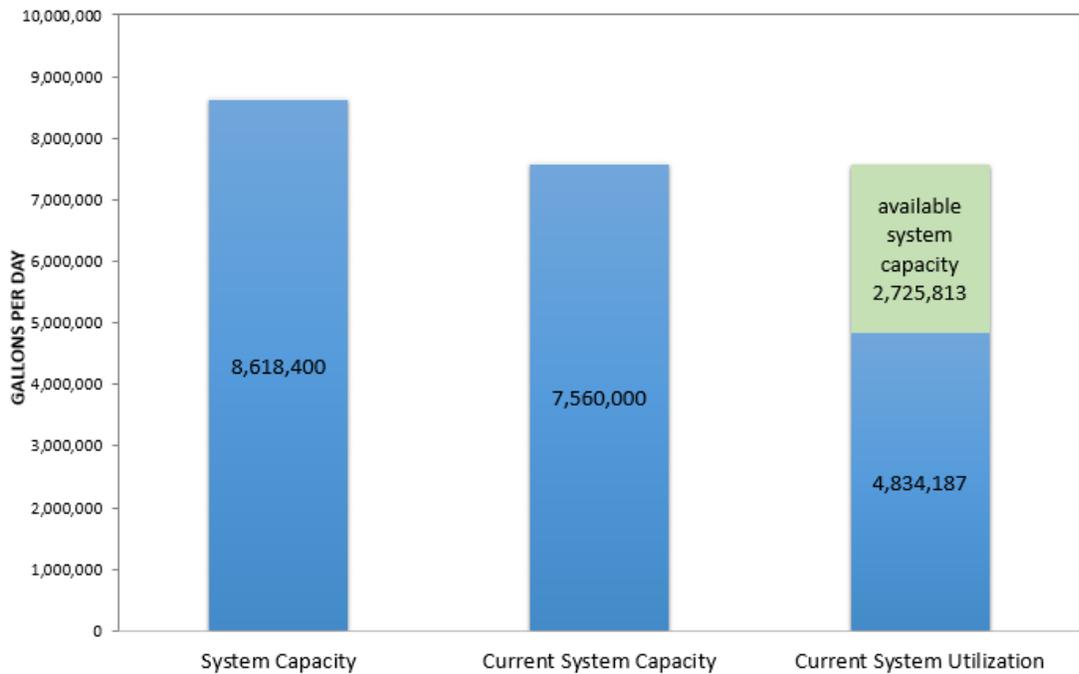

Further Updates and Information

This information will be distributed electronically on the City of Portsmouth’s website in the Department of Public Work’s “Water” section. If anyone needs additional information or has questions contact Brian Goetz, Deputy Director of Public Works at 766-1420 or Al Pratt, Water Resource Manager at 520-0622.

